



SPECIFICATION SHEET

Model EPWFA12

Components

The following fittings are supplied with every system:

ITEM	DESCRIPTION	QTY
1	Everpure QL-1 Threaded Filter Head 3/8" F NPT	1
2	Everpure Filter Cartridge	1
3	Touch-Flo Dispenser Tap	1
4	Cistern Tap with Check Valve	1
5	Pex Hose 3/8 M NPT x G1/2" F x 550mm Long	1
6	Pex Hose 3/8 M NPT x G1/2" F x 7500mm Long	1
7	Adaptor 7/16 UN S F x G1/2" M	1

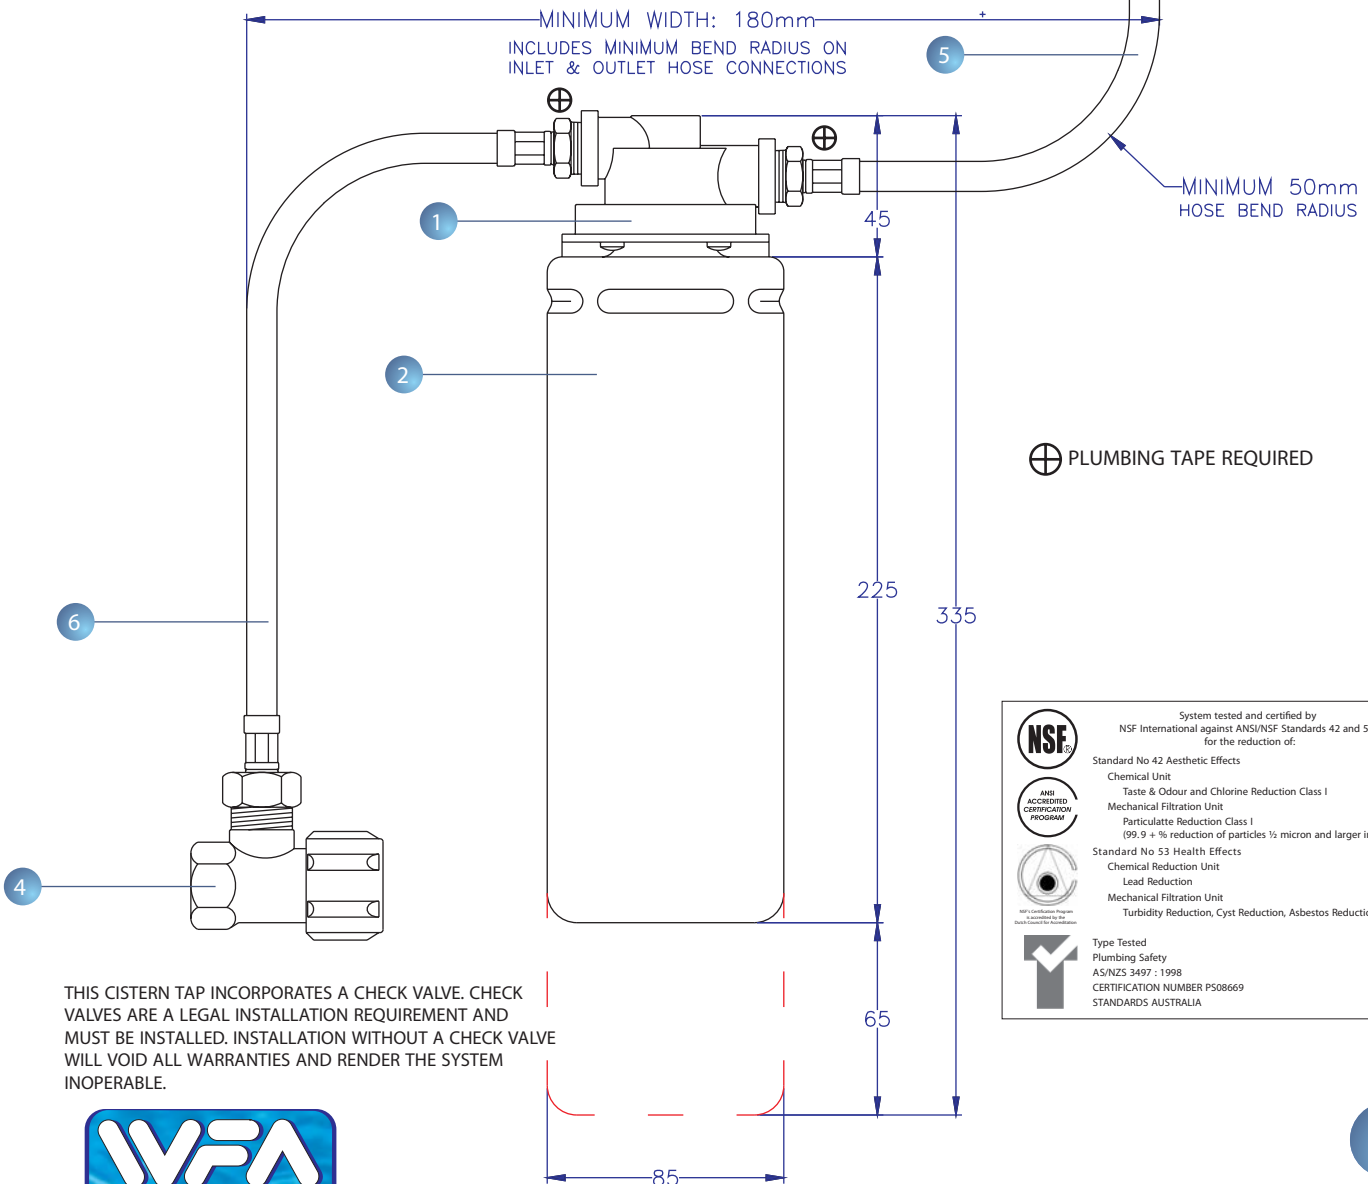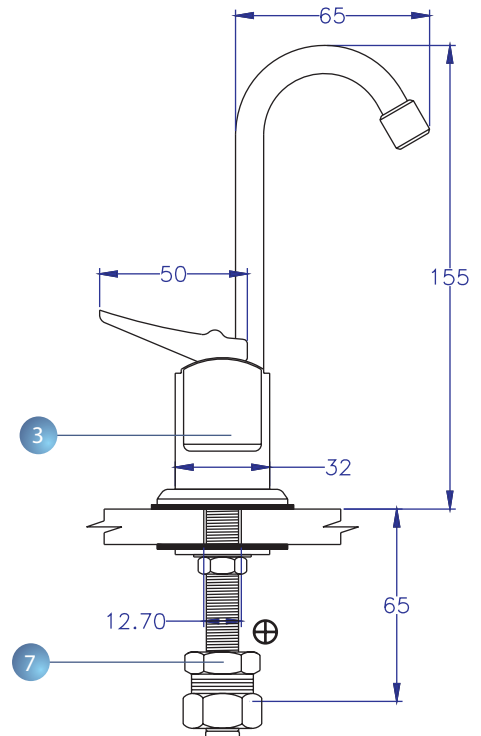

THIS CISTERN TAP INCORPORATES A CHECK VALVE. CHECK VALVES ARE A LEGAL INSTALLATION REQUIREMENT AND MUST BE INSTALLED. INSTALLATION WITHOUT A CHECK VALVE WILL VOID ALL WARRANTIES AND RENDER THE SYSTEM INOPERABLE.

System tested and certified by NSF International against ANSI/NSF Standards 42 and 53 for the reduction of:

- Standard No 42 Aesthetic Effects
 - Chemical Unit
 - Taste & Odour and Chlorine Reduction Class I
- Mechanical Filtration Unit
 - Particulate Reduction Class I (99.9 + % reduction of particles 1/2 micron and larger in size)
- Standard No 53 Health Effects
 - Chemical Reduction Unit
 - Lead Reduction
 - Mechanical Filtration Unit
 - Turbidity Reduction, Cyst Reduction, Asbestos Reduction.

NSF International Program is a member of the International Accreditation Program

Type Tested
 Plumbing Safety
 AS/NZS 3497 : 1998
 CERTIFICATION NUMBER PS08669
 STANDARDS AUSTRALIA

Specifications



Height:	335mm Includes 65mm (2 ½ in) clearance for cartridge change.
Width:	130mm (5 in)
Depth:	130mm (5 in)
Capacity:	2835L (750 gal)
Pressure:	70 - 1200 kPa (min 10psi)
Temperature:	2 - 38oC (35 - 100oF)
Flow Rate:	1.9 lpm (0.5 gpm)
Shipping Weight:	1.56 kg

Schedule of Works

SINK SUPPLIER:

- Provide a 12.70mm (½ in) diameter hole in sink to mount filter tap.
- Hole should be located opposite the general use tap on a flat section of the sink and within 30 mm of the edge of the sink bowl.

Suggested mounting location diagrams:

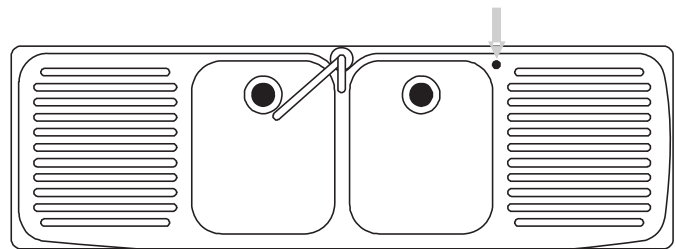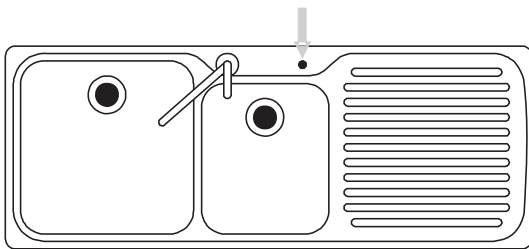

PLUMBER:

- Supply all necessary valving and brassware to provide a separate ½ inch male BSP connection to cold water supply in cupboard underneath kitchen sink.
- Provide additional braided hose to complete connection if required.
- Install the components of the Everpure water filtration system under kitchen sink according to diagram overleaf and system installation instructions. The cistern tap with check valve must be installed as part of the system.
- Ensure that all plumbing work carried out in the installation of the system complies with Australian Standard As3500.
- If a hole is not provided to mount the filter tap, drill or punch a 12.70 mm (½ in) diameter hole in sink following Kitchen Manufacturers instructions above.
- Flush the cold water line before connection to water filter system.
- Fix any leaks if present. Plumbing tape is required on all threaded fittings where sealing washers are not available.
- Leave warranty card, for owner to complete.
- To activate system please run system at full flow for 3 minutes.

Special Notices

- Installation instructions, parts and service availability, and standard warranty are included with the Everpure system when shipped. The system must be installed in accordance with the manufacturers instructions otherwise the warranty will be void.
- The Everpure drinking water system must be maintained according to manufacturer's instructions, including replacement of filter cartridges.
- Do not use the Everpure system with water that is microbiologically unsafe, or of unknown quality without adequate disinfection before or after the system; the Everpure system is certified for cyst reduction and may be used on disinfected waters that may contain filterable cysts.
- The contaminants or other substances removed by the Everpure water treatment system are not necessarily in your water.
- Check for compliance with state and local laws and regulations.

Requirements

Inlet Connection: ½" BSP Male

Install vertically with cartridge hanging down.

Flush new cartridge at full flow for 3 minutes to purge air.

Cartridges require replacement when:

- Capacity is reached.
- Flow becomes too slow.
- Every 12 months minimum.
Which ever occurs first.

No electrical connections required.

* Where water pressure exceeds 1200 kPa a pressure limiting valve should be installed prior to the filter system.